CULTEC RECHARGER® 902HD PRODUCT SPECIFICATIONS

CULTEC RECHARGER® 902HD CHAMBERS ARE DESIGNED FOR UNDERGROUND STORMWATER MANAGEMENT. THE CHAMBERS MAY BE USED FOR RETENTION, RECHARGING DETENTION OR CONTROLLING THE FLOW OF ON-SITE STORMWATER RUNOFF.

COUPLINGS

- I. THE CHAMBERS SHALL BE MANUFACTURED IN THE U.S.A. BY CULTEC, INC. OF BROOKFIELD, CT. (203-775-4416 OR 1-800-428-5832)
- .. THE CHAMBERS SHALL BE DESIGNED AND TESTED IN ACCORDANCE WITH ASTM F2787 "STANDARD PRACTICE FOR STRUCTURAL DESIGN OF THERMOPLASTIC CORRUGATED WALL STORMWATER COLLECTION CHAMBERS.
- THE CHAMBER SHALL BE DESIGNED TO WITHSTAND THE AASHTO DESIGN TRUCK LOAD AND LIVE AND DEAD LOAD FACTORS AS DEFINED BY AASHTO LRFD SECTION 12.12 WHEN INSTALLED ACCORDING TO CULTEC'S RECOMMENDED INSTALLATION INSTRUCTIONS.
- 4. THE CHAMBER SHALL BE STRUCTURAL FOAM INJECTION MOLDED OF BLUE VIRGIN HIGH MOLECULAR WEIGHT IMPACT-MODIFIED POLYPROPYLENE.
- 5. THE CHAMBER SHALL BE ARCHED IN SHAPE.
- 6. THE CHAMBER SHALL BE OPEN-BOTTOMED. 7. THE CHAMBER SHALL BE JOINED USING AN INTERLOCKING OVERLAPPING RIB METHOD. CONNECTIONS MUST BE FULLY SHOULDERED OVERLAPPING RIBS, HAVING NO SEPARATE
- 3. THE NOMINAL CHAMBER DIMENSIONS OF THE CULTEC RECHARGER® 902HD SHALL BE 48 INCHES (1219 mm) TALL, 78 INCHES (1981 mm) WIDE AND 4.10 FEET (1.25 mm) LONG. THE INSTALLÈD LENGTH OF A JOINED RÈCHARGÉR® 902HD SHALL BE 3.67 FEET (1.12 m).
- 9. MULTIPLE CHAMBERS MAY BE CONNECTED TO FORM DIFFERENT LENGTH ROWS. EACH ROW SHALL BEGIN AND END WITH A SEPARATELY FORMED CULTEC RECHARGER® 902HD

END CAP. MAXIMUM INLET OPENING ON THE END CAP IS 24 INCHES (600 mm).

- 10. THE CHAMBER SHALL HAVE TWO SIDE PORTALS TO ACCEPT CULTEC HVLV™ FC-48 FEED CONNECTORS TO CREATE AN INTERNAL MANIFOLD. MAXIMUM ALLOWABLE PIPE SIZE IN THE SIDE PORTAL IS 11.5 INCHES (292 mm).
- 11. THE NOMINAL CHAMBER DIMENSIONS OF THE CULTEC HVLV™ FC-48 FEED CONNECTOR SHALL BE 12 INCHES (305 mm) TALL, 16 INCHES (406 mm) WIDE AND 49 INCHES (1245 mm)
- 12. THE NOMINAL STORAGE VOLUME OF THE RECHARGER® 902HD CHAMBER SHALL BE 17.66 FT³ / FT (1.641 m³ / m) - WITHOUT STONE. THE NOMINAL STORAGE VOLUME OF A JOINED RECHARGER® 902HD SHALL BE 64.75 FT3 / UNIT (1.834 m3 / UNIT) - WITHOUT STONE.
- 13. THE NOMINAL STORAGE VOLUME OF THE HVLV™ FC-48 FEED CONNECTOR SHALL BE 0.913 FT³ / FT (0.085 m³ / m) - WITHOUT STONE.
- 14.THE RECHARGER® 902HD CHAMBER SHALL HAVE TWENTY-FOUR DISCHARGE HOLES BORED INTO THE SIDEWALLS OF THE UNIT'S CORE TO PROMOTE LATERAL CONVEYANCE
- 15. THE RECHARGER® 902HD CHAMBER SHALL HAVE 7 CORRUGATIONS.
- 16. THE CHAMBER SHALL HAVE A RAISED INTEGRAL CAP AT THE TOP OF THE ARCH NEAR THE CENTER OF EACH UNIT TO BE USED AS AN OPTIONAL INSPECTION PORT OR CLEAN-OUT.
- 17. THE UNITS MAY BE TRIMMED TO CUSTOM LENGTHS BY CUTTING BACK TO ANY CORRUGATION
- 18. THE CHAMBER SHALL BE MANUFACTURED IN A FACILITY EMPLOYING CULTEC'S QUALITY CONTROL AND ASSURANCE PROCEDURES.
- 19. MAXIMUM ALLOWABLE COVER OVER THE TOP OF THE CHAMBER SHALL BE 8.3 FEET

END CAP PARAMETERS

- THE CULTEC RECHARGER® 902HD END CAP (REFERRED TO AS 'END CAP') SHALL BE MANUFACTURED IN THE U.S.A. BY CULTEC, INC. OF BROOKFIELD, CT. (203-775-4416 OR 1-800-428-5832)
- .. THE END CAP SHALL BE TWIN-SHEET THERMOFORMED OF BLACK VIRGIN HIGH MOLECULAR WEIGHT POLYETHYLENE.
- 3. THE END CAP SHALL BE JOINED AT THE BEGINNING AND END OF EACH ROW OF CHAMBERS USING AN INTERLOCKING OVERLAPPING RIB METHOD. CONNECTIONS MUST BE FULLY SHOULDERED OVERLAPPING RIBS, HAVING NO SEPARATE COUPLINGS.
- 4. THE NOMINAL DIMENSIONS OF THE END CAP SHALL BE 48.5 INCHES (1231 mm) TALL, 78 INCHES (1982 mm) WIDE AND 9.7 INCHES (246 mm) LONG. WHEN JOINED WITH A RECHARGER 902HD CHAMBER, THE INSTALLED LENGTH OF THE END CAP SHALL BE 6.2
- 5. THE NOMINAL STORAGE VOLUME OF THE END CAP SHALL BE 5.34 FT3 / FT (0.50 m3 / m) -WITHOUT STONE. THE NOMINAL STORAGE VOLUME OF AN INTERLOCKED END CAP SHALL BE 2.76 FT³ / UNIT (0.08 m³ / UNIT) - WITHOUT STONE.
- 6. MAXIMUM INLET OPENING ON THE END CAP IS 24 INCHES (600 mm).
- . THE END CAP SHALL PROVIDE RESISTANCE TO THE LOADS AND LOAD FACTORS AS DEFINED IN THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS SECTION 12.12.

CULTEC HVLV FC-48 FEED CONNECTOR PRODUCT SPECIFICATIONS

CULTEC HVLV FC-48 FEED CONNECTORS ARE DESIGNED TO CREATE AN INTERNAL MANIFOLD FOR CULTEC RECHARGER MODEL 902HD STORMWATER CHAMBERS.

FEED CONNECTOR PARAMETERS 1. THE FEED CONNECTOR SHALL BE MANUFACTURED BY CULTEC, INC. OF BROOKFIELD, CT.

- (203-775-4416 OR 1-800-428-5832)
- 2. THE FEED CONNECTOR SHALL BE VACUUM THERMOFORMED OF BLACK HIGH MOLECULAR WFIGHT HIGH DENSITY POLYETHYLENE (HMWHDPE).
- 3. THE FEED CONNECTOR SHALL BE ARCHED IN SHAPE.
- 4. THE FEED CONNECTOR SHALL BE OPEN-BOTTOMED.
- 5. THE NOMINAL DIMENSIONS OF THE CULTEC HVLV FC-48 FEED CONNECTOR SHALL BE 12
- INCHES (305 mm) TALL, 16 INCHES (406 mm) WIDE AND 49 INCHES (1245 mm) LONG. 6. THE NOMINAL STORAGE VOLUME OF THE HVLV FC-48 FEED CONNECTOR SHALL BE 0.913 FT³ / FT (0.085 m³/m) - WITHOUT STONE.

7. THE HVLV FC-48 FEED CONNECTOR SHALL HAVE 4 CORRUGATIONS.

- 8. THE HVLV FC-48 FEED CONNECTOR MUST BE FORMED AS A WHOLE UNIT HAVING TWO OPEN END WALLS AND HAVING NO SEPARATE END PLATES OR SEPARATE END WALLS. THE UNIT SHALL FIT INTO THE SIDE PORTALS OF THE CULTEC RECHARGER STORMWATER CHAMBER AND ACT AS CROSS FEED CONNECTIONS CREATING AN INTERNAL MANIFOLD.
- 9. THE FEED CONNECTOR SHALL BE DESIGNED TO WITHSTAND AASHTO HS-25 DEFINED LOADS WHEN INSTALLED ACCORDING TO CULTEC'S RECOMMENDED INSTALLATION INSTRUCTIONS.
- 10. THE FEED CONNECTOR SHALL BE MANUFACTURED IN AN ISO 9001:2008 CERTIFIED FACILITY.

CULTEC NO. 410™ NON-WOVEN GEOTEXTILE

CULTEC NO. 410™ NON-WOVEN GEOTEXTILE MAY BE USED WITH CULTEC CONTACTOR® AND RECHARGER® STORMWATER INSTALLATIONS TO PROVIDE A BARRIER THAT PREVENTS SOIL INTRUSION INTO THE STONE.

GEOTEXTILE PARAMETERS

- 1. THE GEOTEXTILE SHALL BE PROVIDED BY CULTEC, INC. OF BROOKFIELD, CT. (203-775-4416 OR 1-800-428-5832)
- 2. THE GEOTEXTILE SHALL BE BLACK IN APPEARANCE.
- 3. THE GEOTEXTILE SHALL HAVE A TYPICAL WEIGHT OF 4.5 OZ/SY (142 G/M).
- 4. THE GEOTEXTILE SHALL HAVE A TENSILE STRENGTH VALUE OF 120 LBS (533 N) PER ASTM D4632 TESTING METHOD.
- 5. THE GEOTEXTILE SHALL HAVE AN ELONGATION @ BREAK VALUE OF 50% PER ASTM D4632 TESTING METHOD
- 6. THE GEOTEXTILE SHALL HAVE A MULLEN BURST VALUE OF 225 PSI (1551 KPA) PER ASTM D3786 TESTING METHOD.
- 7. THE GEOTEXTILE SHALL HAVE A PUNCTURE STRENGTH VALUE OF 65 LBS (289 N) PER
- ASTM D4833 TESTING METHOD. 8. THE GEOTEXTILE SHALL HAVE A CBR PUNCTURE VALUE OF 340 LBS (1513 N) PER
- ASTM D6241 TESTING METHOD. 9. THE GEOTEXTILE SHALL HAVE A TRAPEZOID TEAR VALUE OF 50 LBS (222 N) PER ASTM D4533 TESTING METHOD.
- 10. THE GEOTEXTILE SHALL HAVE A AOS VALUE OF 70 U.S. SIEVE (0.212 MM) PER ASTM D4751 TESTING METHOD.
- 11. THE GEOTEXTILE SHALL HAVE A PERMITTIVITY VALUE OF 1.7 SEC-1 PER ASTM D4491 TESTING METHOD.
- 12. THE GEOTEXTILE SHALL HAVE A WATER FLOW RATE VALUE OF 135 GAL/MIN/SF
- (5500 L/MIN/SM) PER ASTM D4491 TESTING METHOD. 13. THE GEOTEXTILE SHALL HAVE A UV STABILITY @ 500 HOURS VALUE OF 70% PER
- ASTM D4355 TESTING METHOD.

CULTEC NO. 4800™ WOVEN GEOTEXTILE

CULTEC NO. 4800 WOVEN GEOTEXTILE IS DESIGNED AS A UNDERLAYMENT TO PREVENT SCOURING CAUSED BY WATER MOVEMENT WITHIN THE CULTEC CHAMBERS AND FEED CONNECTORS UTILIZING THE CULTEC MANIFOLD FEATURE. IT MAY ALSO BE USED AS A COMPONENT OF THE CULTEC SEPARATOR ROW TO ACT AS A BARRIER TO PREVENT SOIL/CONTAMINANT INTRUSION INTO THE STONE WHILE ALLOWING FOR MAINTENANCE.


GEOTEXTILE PARAMETERS

D4355 TESTING METHOD.


- THE GEOTEXTILE SHALL BE PROVIDED BY CULTEC, INC. OF BROOKFIELD, CT.
- (203-775-4416 OR 1-800-428-5832) 2. THE GEOTEXTILE SHALL BE BLACK IN APPEARANCE.
- THE GEOTEXTILE SHALL HAVE A TENSILE STRENGTH OF 550 X 550 LBS (2,448 X 2.448 N) PER ASTM D4632 TESTING METHOD.
- 4. THE GEOTEXTILE SHALL HAVE A ELONGATION @ BREAK RESISTANCE OF 20 X 20% PER ASTM D4632 TESTING METHOD.
- 5. THE GEOTEXTILE SHALL HAVE A WIDE WIDTH TENSILE RESISTANCE OF 5,070 X 5,070 LBS/FT
- (74 X 74 KN/M) PER ASTM D4595 TESTING METHOD. THE GEOTEXTILE SHALL HAVE A WIDE WIDTH TENSILE RESISTANCE @ 2% STRAIN OF 960 X 1,096 LBS/FT
- (14 X 16 KN/M) PER ASTM D4595 TESTING METHOD. THE GEOTEXTILE SHALL HAVE A WIDE WIDTH TENSILE RESISTANCE @ 5% STRAIN
- OF 2,740 X 2, 740 LBS/FT (40 X 40 KN/M) PER ASTM D4595 TESTING METHOD. 8. THE GEOTEXTILE SHALL HAVE A WIDE WIDTH TENSILE RESISTANCE @ 10%
- STRAIN OF 4,800 X 4,800 LBS/FT (70 X 70 KN/M) PER ASTM D4595 TESTING 9. THE GEOTEXTILE SHALL HAVE A CBR PUNCTURE RESISTANCE OF 1,700 LBS (7,560
- N) PER ASTM D6241 TESTING METHOD. 10. THE GEOTEXTILE SHALL HAVE A TRAPEZOIDAL TEAR RESISTANCE OF 180 X 180 LBS
- (801 X 801 N) PER ASTM D4533 TESTING METHOD. 11. THE GEOTEXTILE SHALL HAVE AN APPARENT OPENING SIZE OF 40 US STD. SIEVE
- (0.425 MM) PER ASTM D4751 TESTING METHOD. 12. THE GEOTEXTILE SHALL HAVE A PERMITTIVITY RATING OF 0.15 SEC-1 PER ASTM
- D4491 TESTING METHOD. 13. THE GEOTEXTILE SHALL HAVE A WATER FLOW RATING OF 11.5 GPM/FT2 (470
- LPM/M2) PER ASTM D4491 TESTING METHOD. 14. THE GEOTEXTILE SHALL HAVE A UV RESISTANCE OF 80% @ 500 HRS. PER ASTM

- PAVEMENT SUB-BASE (WHEN APPLICABLE) MINIMUM 95% COMPACTED FILL CULTEC NO. 410 NON-WOVEN GEOTEXTILE AROUND STONE. TOP AND SIDES MANDATORY BOTTOM PER ENGINEER'S DESIGN PREFERENCE - CULTEC HVLV FC-48 FEED CONNECTOR WHERE SPECIFIED 12.0 INCH MIN. DEPTH OF 1-2 INCH WASHED CRUSHED STONE ABOVE CHAMBERS 12.0' MIN CULTEC NO. 4800 WOVEN GEOTEXTILE CULTEC RECHARGER 902HD PLACED BENEATH INLET PIPES HEAVY-DUTY CHAMBER 12.0 INCH MIN. WIDTH OF 1-2 INCH WASHED CRUSHED STONE BORDER SURROUNDING ALL CHAMBERS **CULTEC NO. 4800 WOVEN GEOTEXTILE** PLACED BENEATH FEED CONNECTORS 9.0 INCH MIN. DEPTH OF 1-2 INCH WASHED CRUSHED STONE BENEATH CHAMBERS - PIPE DESIGN AND ELEVATION TBD BY ENGINEER. PIPE TO BE INSERTED 8.0 INCHES MIN. INTO CHAMBER. MAX. 24.0 INCHES I.D. ALLOWED IN ENDWALL


- PAVEMENT OR FINISHED GRADE

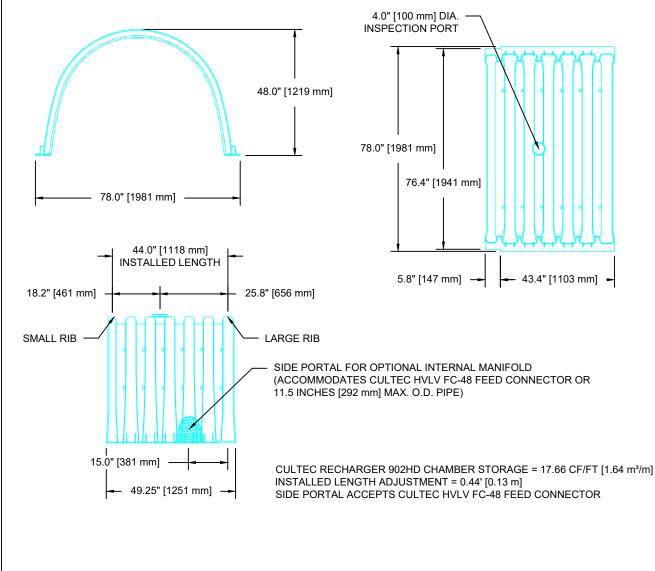


CULTEC RECHARGER 902HD HEAVY DUTY THREE VIEW

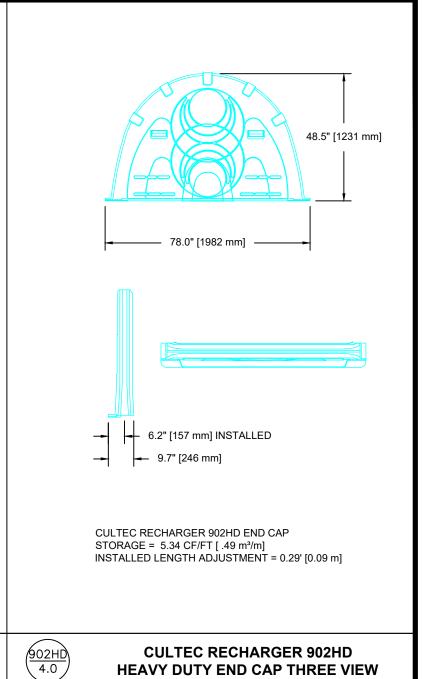

CULTEC RECHARGER 902HD HEAVY DUTY PLAN VIEW

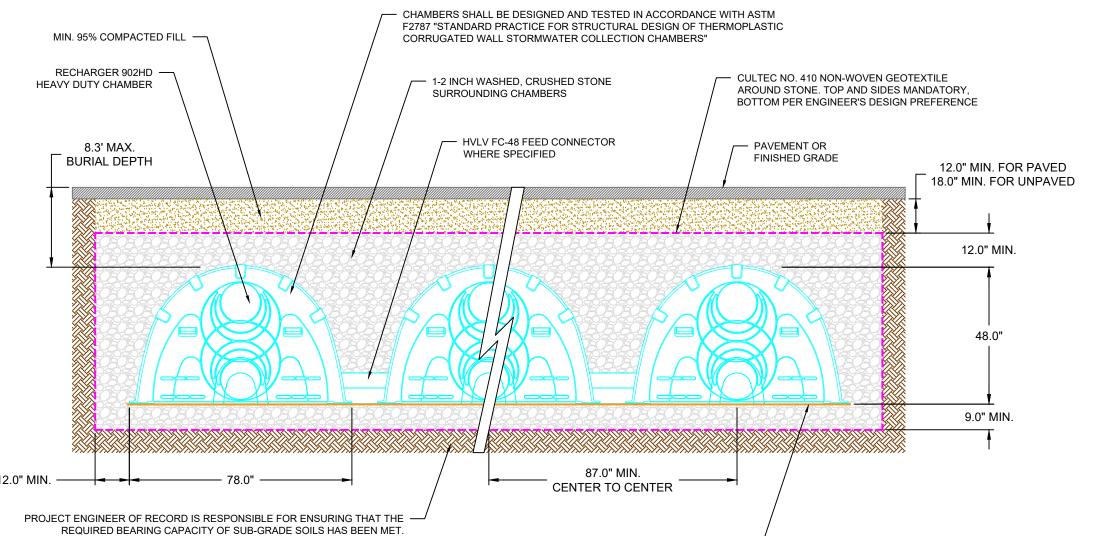

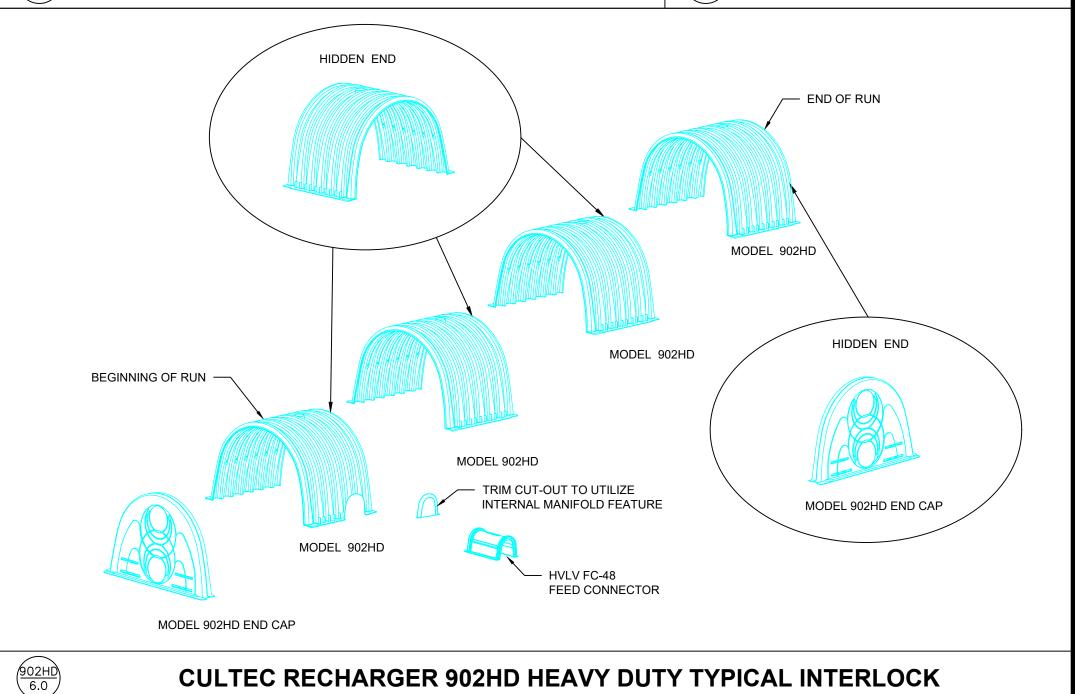



CULTEC RECHARGER 902HD HEAVY DUTY CROSS SECTION

902HD 9.0

CULTEC NO. 4800 WOVEN GEOTEXTILE TO BE PLACED BENEATH INTERNAL MANIFOLD

FEATURE AND BENEATH ALL INLET/OUTLET PIPES (FOR SCOUR PROTECTION)

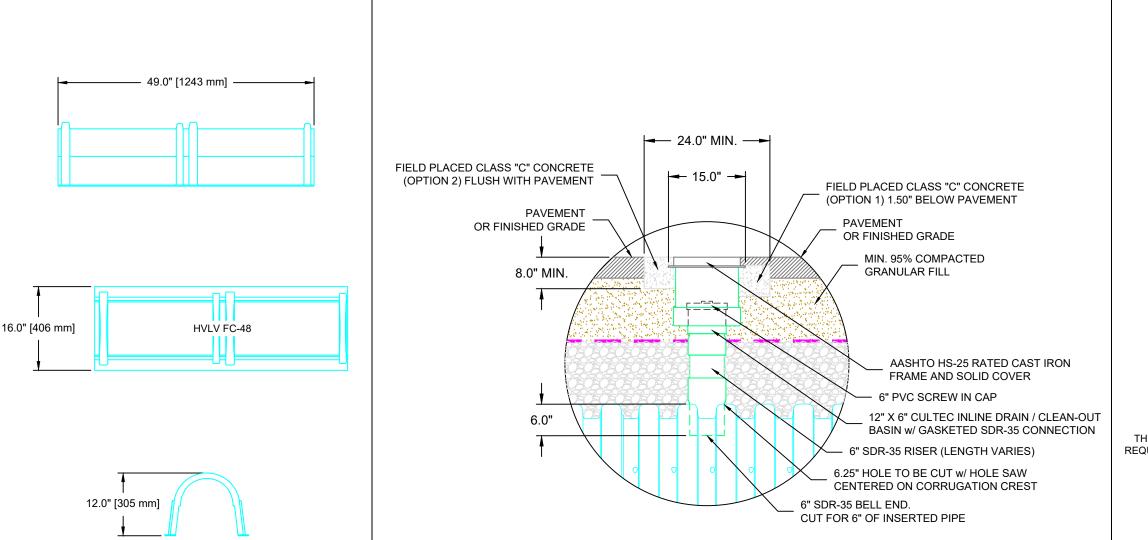


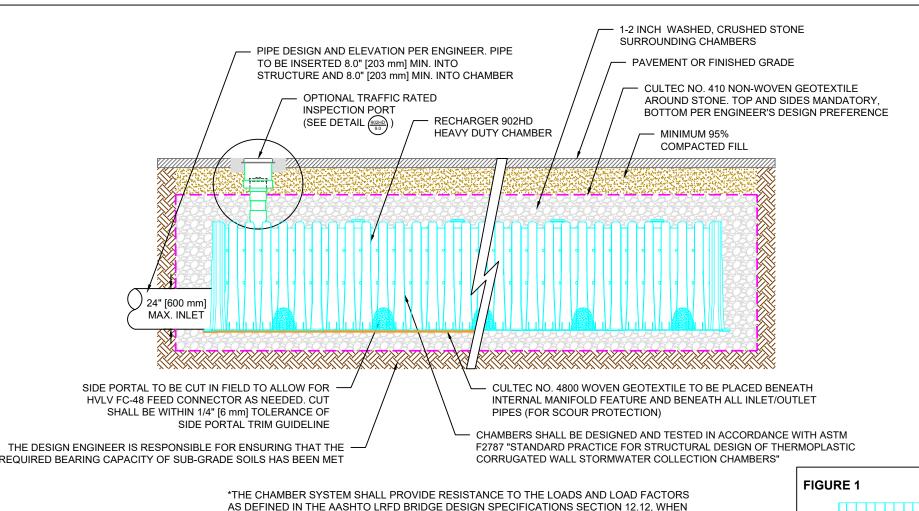

INSTALLED ACCORDING TO CULTEC'S RECOMMENDED INSTALLATION INSTRUCTIONS.

SCALE:


N.T.S.



GENERAL NOTES

PIPE	Α	В
6" [150 mm]	N/A	N/A
8" [200 mm]	N/A	N/A
10" [250 mm]	N/A	N/A
12" [300 mm]	29.50" [749 mm]	2.25" [57 mm]
15" [375 mm]	26.50" [673 mm]	2.25" [57 mm]
18" [450 mm]	23.50" [597 mm]	2.50" [64 mm]
24" [600 mm]	16.50" [420 mm]	3.00" [76 mm]

THE TYPICAL INVERT TABLE ABOVE IS BASED ON THE INSIDE DIAMETER OF STANDARD CORRUGATED PLASTIC PIPE. THE HEAVY DUTY END CAP HAS PRE-MARKED TRIM LINES FOR PIPE DIAMETERS 12" (300mm), 15" (375mm), 18" (450mm) AND 24" (600mm). PIPES OF ANY SIZE AND MATERIAL UP TO 24" MAY BE PLACED AT CUSTOM LOCATIONS AND CUSTOM INVERTS. THE CROWN OF THE PIPE MUST REMAIN A MINIMUM OF 4" (100mm) FROM THE EDGE OF THE HEAVY DUTY END CAP

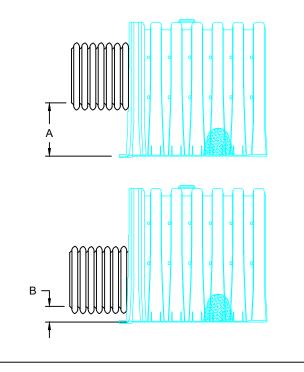

CULTEC HVLV FC-48 FEED CONNECTOR THREE VIEW

OPTIONAL INSPECTION PORT - ZOOM DETAIL

RECHARGER 902HD

902HD

CULTEC INTERNAL MANIFOLD - OPTIONAL INSPECTION PORT DETAIL CULTEC STORMWATER CHAMBER PROJECT NO: 18-DATE: CHECKED BY: DG DESIGNED BY: -

SHEET NO:

- MAX.= 12" PVC PIP

ZOOM OF SIDE PORTAL SHOWING MAX. PIPE

4 OF -

CULTEC

CULTEC, Inc.

Subsurface Stormwater Management Systems

P.O. Box 280 878 Federal Road Brookfield, CT 06804 www.cultec.com

PH: (203) 775-4416 PH: (800) 4-CULTEC FX: (203) 775-1462 tech@cultec.com

CULTEC RECHARGER 902HD TYPICAL PIPE INVERTS

THIS DRAWING WAS PREPARED TO SUPPORT THE PROJECT ENGINEER OF RECORD FOR THE PROPOSED SYSTEM. IT IS THE ULTIMATE RESPONSIBILITY OF THE PROJECT ENGINEER OF RECORD TO ENSURE THAT THE CULTEC SYSTEM'S DESIGN IS IN FULL COMPLIANCE WITH ALL APPLICABLE LAWS AND REGULATIONS. IT IS THE PROJECT ENGINEER OF RECORD'S RESPONSIBILITY TO ENSURE THAT THE CULTEC PRODUCTS ARE DESIGNED IN ACCORDANCE WITH CULTEC'S MINIMUM REQUIREMENTS. CULTEC DOES NOT APPROVE PLANS, SIZING, OR SYSTEM DESIGNS.

DETAIL SHEET TRAFFIC APPLICATION